

# Example report

## Temperature and Humidity

Poor

31/Oct/2025 to 15/Nov/2025

01 02 03 04 05 06 07 08 09 10 11 12 13 14  
Sa Su Mo Tu We Th Fr Sa Su Mo Tu We Th Fr

### Temperature °C

	Outside	11	8	13	14	15	14	12	11	10	11	11	13	12	9
Lounge/Diner		20	19	19	19	20	20	20	19	18	17	17	17	19	16
Kitchen		20	19	19	19	20	21	20	19	18	18	17	17	19	17
Hallway Upstairs		18	17	17	18	19	19	19	18	16	16	16	16	18	15
Bathroom		19	19	18	18	19	20	19	18	16	17	16	17	19	16
Bedroom2		20	20	19	18	19	20	19	19	17	17	16	16	18	16
Bedroom1		19	19	19	19	20	20	20	19	17	17	16	17	19	17
Bedroom3		18	18	18	18	19	20	20	19	17	17	16	16	18	16

### Humidity %

	Outside	78	81	83	83	84	88	94	90	91	94	89	92	86	95
Lounge/Diner		65	63	64	66	68	67	66	66	65	69	68	71	69	70
Kitchen		64	63	64	66	67	66	65	66	65	68	67	71	68	69
Hallway Upstairs		70	69	70	71	72	71	71	71	71	73	72	75	74	73
Bathroom		72	71	72	74	75	75	74	73	73	76	77	81	78	79
Bedroom2		68	67	67	68	71	71	70	71	71	72	70	74	72	72
Bedroom1		68	67	67	69	70	70	69	68	68	70	69	73	71	71
Bedroom3		73	73	72	72	72	73	71	71	70	71	71	74	73	73

# Example report

<b>Pass</b>	● 3 of 9	<b>44%</b>
<b>Advisory</b>	● 2 of 9	
<b>Immediate Attention</b>	● 4 of 9	
<b>Under 18°C with many high peaks - check heating timers</b>		
Hallway Upstairs, Bathroom, Bedroom2, Bedroom1, Bedroom3	●	
<b>Moderate Natural Ventilation - increase use of trickle vents</b>		
Bathroom	●	
<b>Purge Ventilation is Poor - check habits</b>		
Lounge/Diner, Kitchen, Hallway Upstairs, Bathroom, Bedroom2, Bedroom1, Bedroom3	●	
<b>Poor moisture balance - consider constant ventilation</b>		
Lounge/Diner, Kitchen, Hallway Upstairs, Bathroom, Bedroom2, Bedroom1, Bedroom3	●	
<b>Poor Moisture extraction - check Bathroom/Kitchen fans</b>		
Bathroom	●	
<b>Good Wall Performance</b>		
18°C (min) and 52% (max) humidity internal conditions would reduce the condensation risk to walls	●	
<b>A dehumidifier may be needed</b>		
No rooms in this category	●	
<b>Low Mould Risk</b>		
Lounge/Diner, Kitchen, Hallway Upstairs, Bathroom, Bedroom2, Bedroom1, Bedroom3	●	
<b>Increase temperature and reduce moisture</b>		
Hallway Upstairs, Bathroom, Bedroom3	●	

# Example report

<b>Bedroom1</b>		<b>Medium</b>
18°C average temperature. Slight downward trend in temperature	●	
Under 18°C with many high peaks - check heating timers		
69% average humidity. Slight decrease in the trend	●	
Very High Humidity (more than 65%)		
Good Natural Ventilation	●	
Purge Ventilation is Poor - check habits	●	
Low Mould Risk	●	


## Bathroom and Kitchen Fans

**Poor**

	Peaks starting more than 65% humidity and still above 60% after 2 hours			Improvement needed to remove moisture	
	time of day	°C	Peaks	Improve*	time to remove
<b>Kitchen</b>	13:00	21°C	4	2times	34mins
<b>Bathroom</b>	13:00	19°C	21	2times	30mins

# Example report

## Graphs Temperature °C

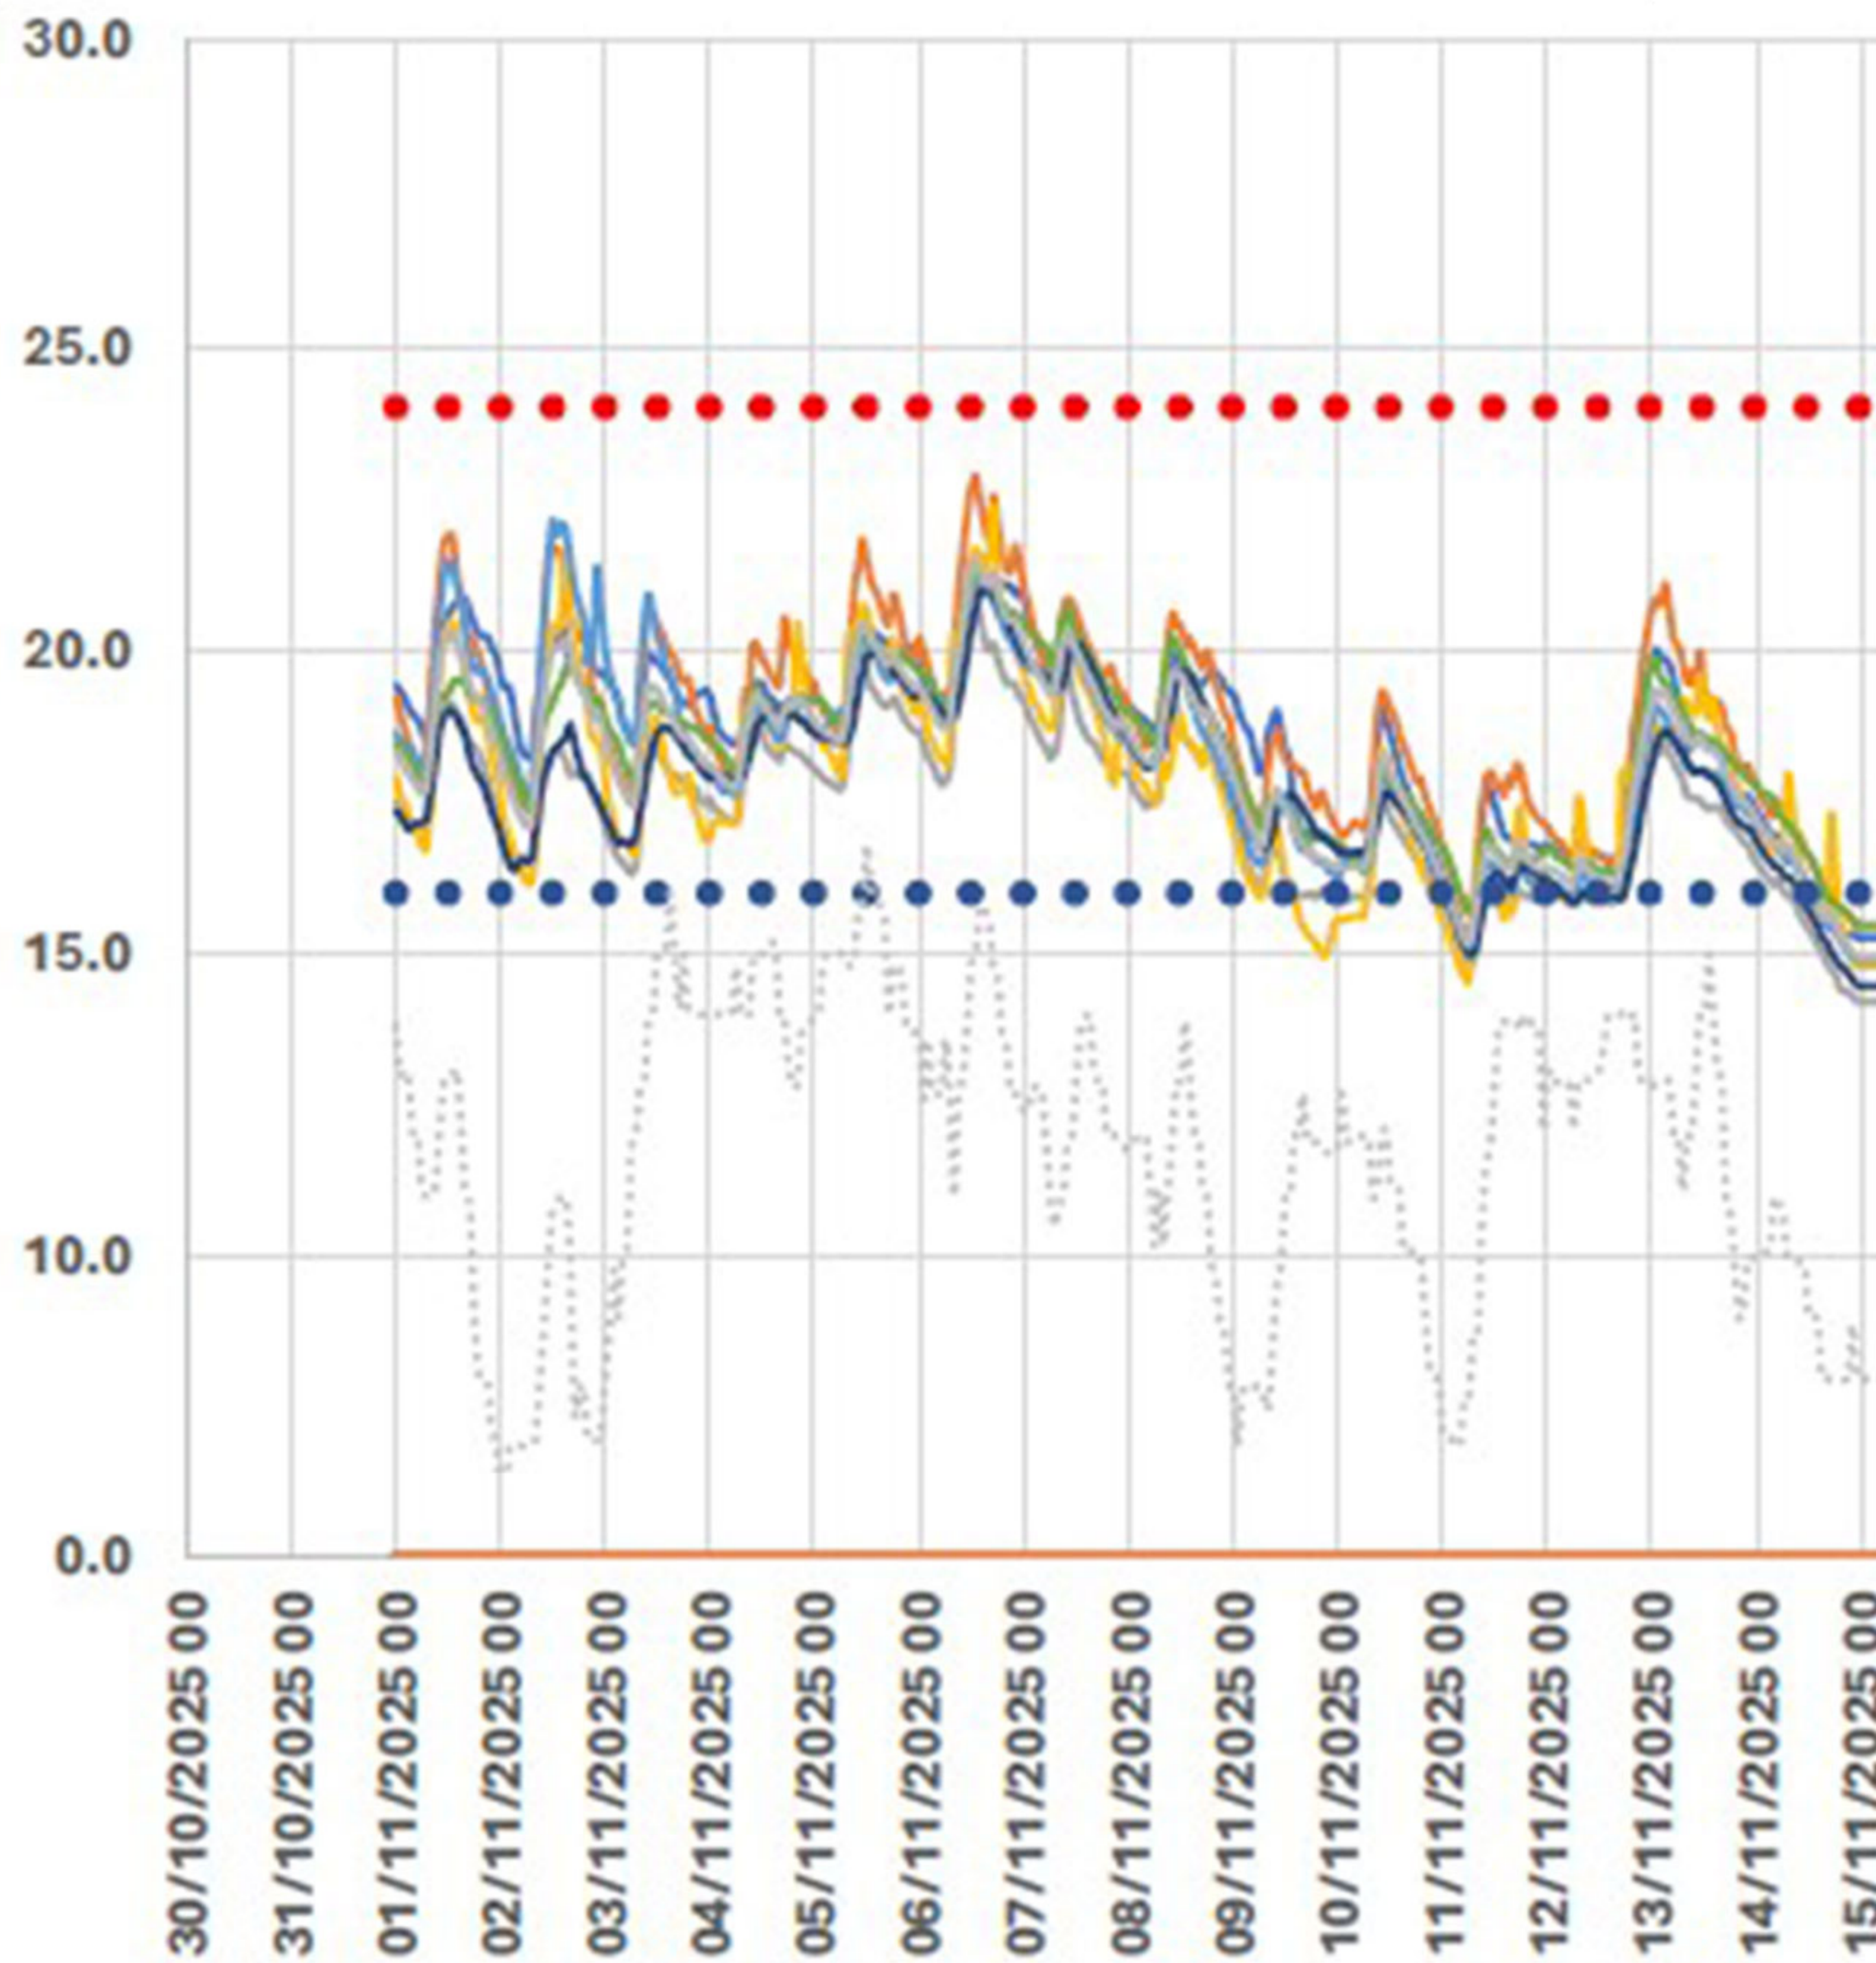

- |                |               |                    |                |
|----------------|---------------|--------------------|----------------|
| — Lounge/Diner | — Kitchen     | — Hallway Upstairs | — Bathroom     |
| — Bedroom2     | — Bedroom1    | — Bedroom3         | —              |
| —              | —             | —                  | —              |
| —              | —             | — avg line         | ••••• 24c line |
| ••••• 16c line | ..... outside |                    |                |